




PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS




RECLAIMED WATER



SEWER




POTABLE WATER



FIRE LINE

TYPICAL VALVE BOX COVER DETAILS

NOTE: COVERS AND RINGS TO TRAFFIC RATED PER FDOT STANDARDS AND SPECIFICATIONS.

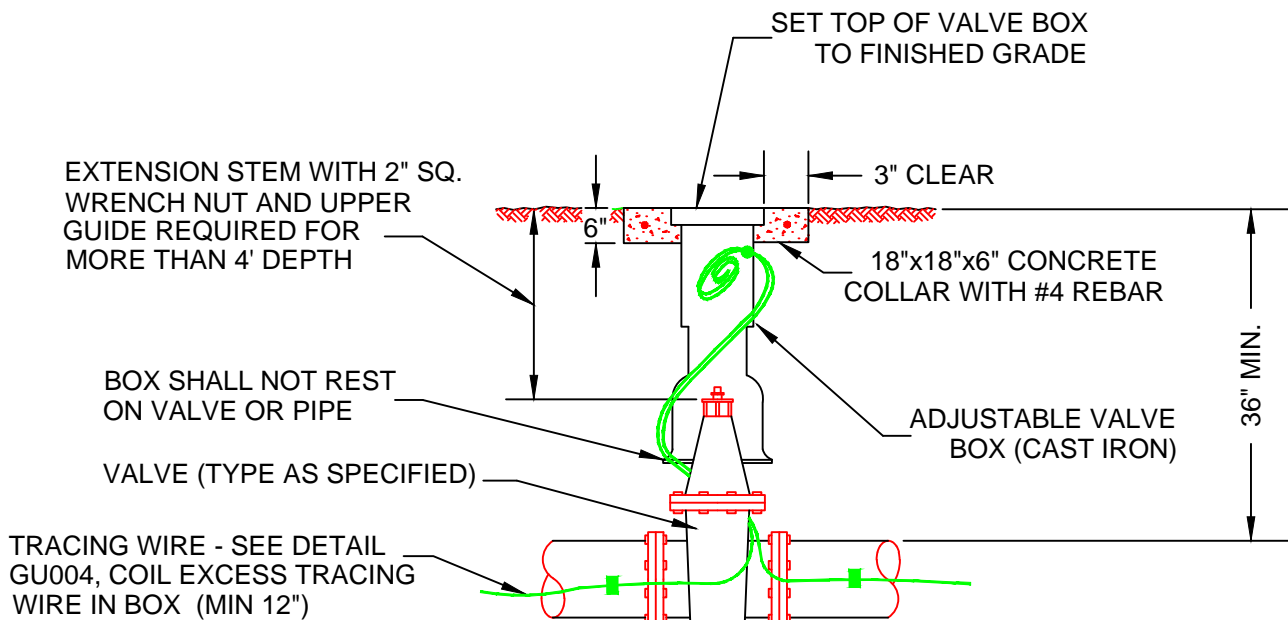

TYPICAL VALVE AND VALVE BOX DETAIL

ADDITIONAL REFERENCE: FIRE HYDRANT DETAIL PW002-4.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

VALVE, VALVE BOX & COVER

GU005-3

ISSUED 2017

REVISED 03/01/2017 BY DJB