


PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

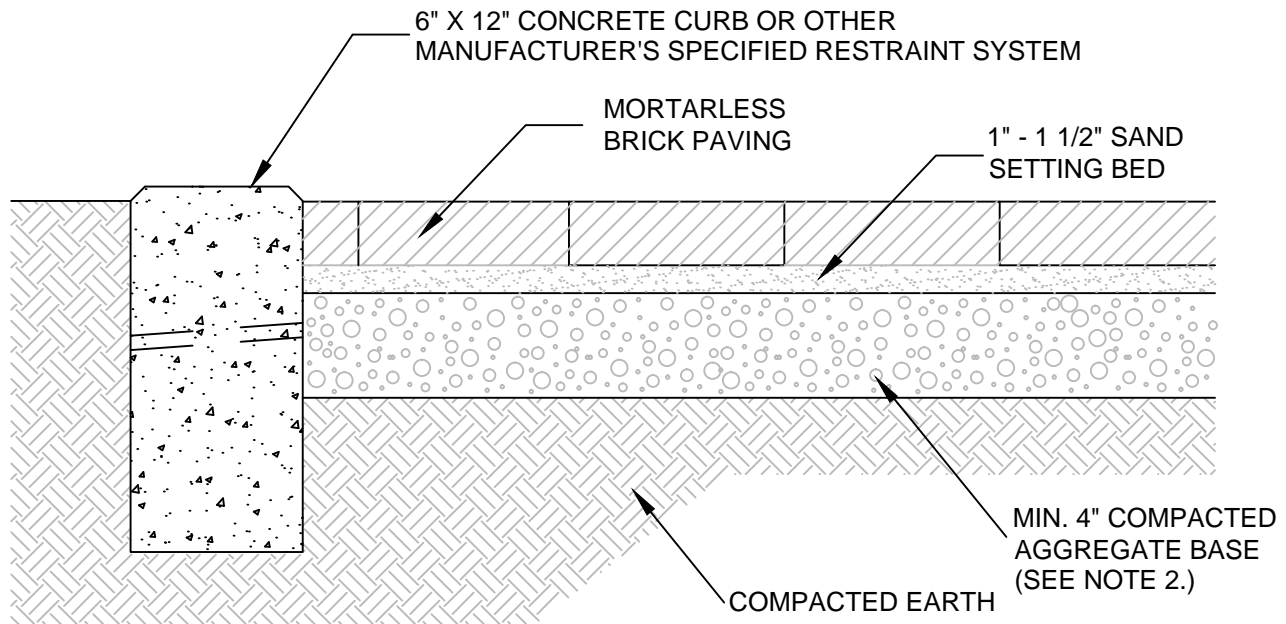

MORTARLESS BRICK PAVING

CONCRETE CURB EDGING

DRIVEWAY APRON

NOTES:

1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
2. A SUBGRADE CONSISTING OF GRADED AGGREGATES AND/OR GEOTEXTILE FABRIC MAY BE REQUIRED WHEN SUBGRADE CONDITIONS ARE POOR.
3. PAVEMENTS SUBJECTED TO VEHICULAR TRAFFIC MUST BE DESIGNED BY A PROFESSIONAL ENGINEER TO ACCOMMODATE WHEEL LOADS.
4. THE PAVING SYSTEM SHOULD BE SLOPED A MINIMUM OF 1/4" PER FOOT AWAY FROM BUILDINGS, RETAINING WALLS AND OTHER ELEMENTS CAPABLE OF COLLECTING OR RESTRICTING RUNOFF.



CITY OF ALTAMONTE SPRINGS
950 CALABRIA DRIVE
ALTAMONTE SPRINGS, FLORIDA 32714

BRICK PAVING ASSEMBLIES

MI018-0

ISSUED 2017

REVISED 03/01/2017 BY DJB