



# PUBLIC WORKS & UTILITIES ENGINEERING & DESIGN STANDARDS

SERVICE LINE PURPLE  
(DR-9 POLYETHYLENE).

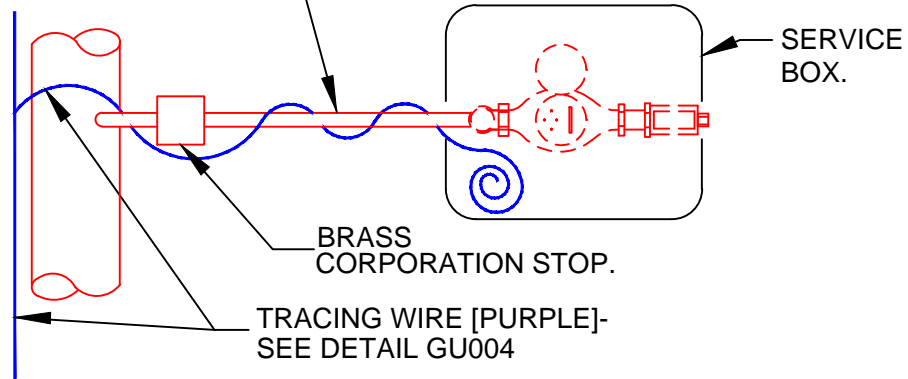

**PLAN**

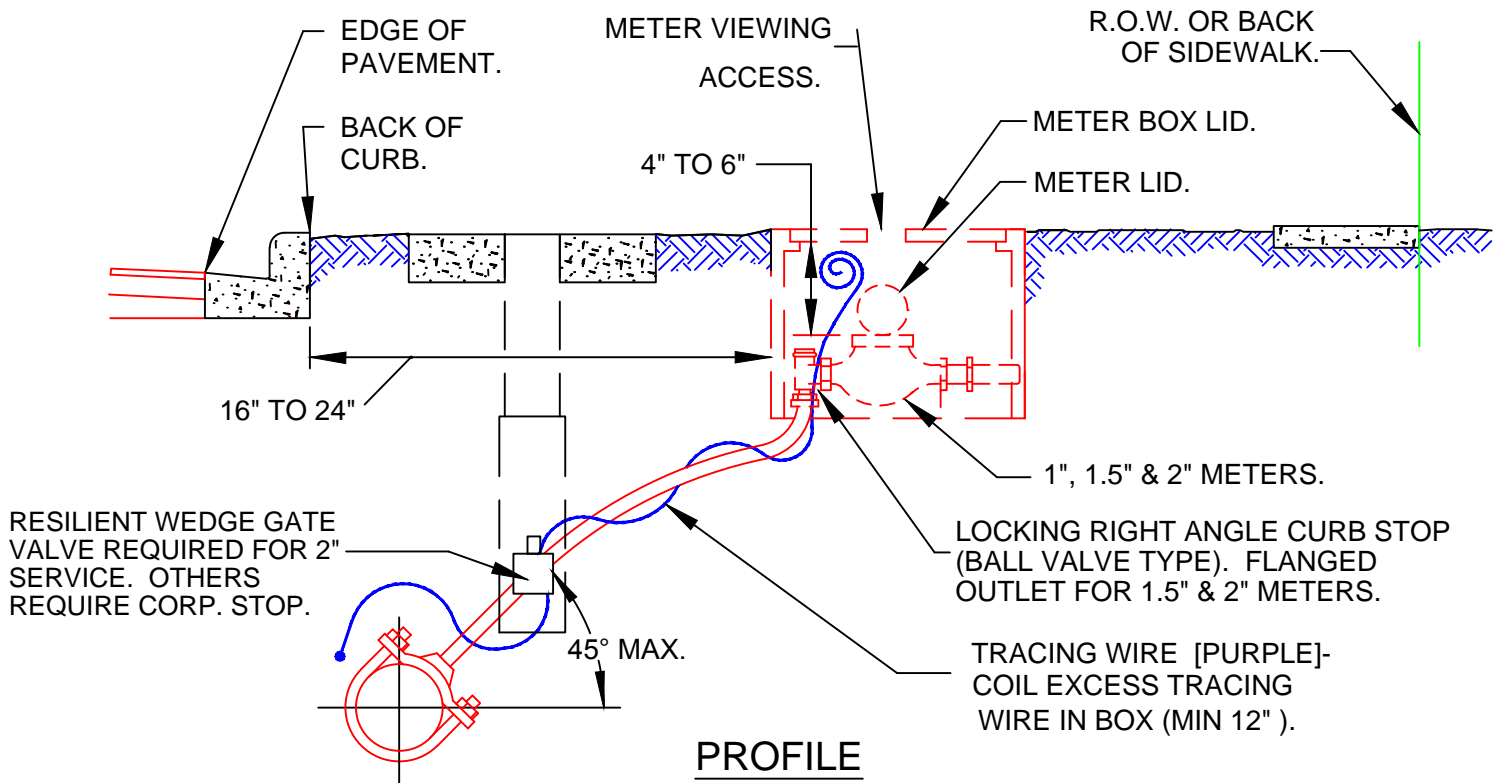

**PROFILE**

**NOTES:**

1. SERVICE BOX FURNISHED BY CITY OF ALTAMONTE SPRINGS.
2. METER SHALL BE INSTALLED BETWEEN SIDEWALK AND CURB AND IN NO CASE SHALL IT BE INSTALLED IN SIDEWALK OR OTHER PAVED AREAS.
3. SERVICE LINES SHALL NOT BE LESS THAN METER SIZE.



CITY OF ALTAMONTE SPRINGS  
950 CALABRIA DRIVE  
ALTAMONTE SPRINGS, FLORIDA 32714

## RECLAIMED WATER COMMERCIAL - SINGLE SERVICE CONNECTION

**RW006-1**

ISSUED 2017

REVISED 03/01/2017 BY DJB